


配水量・漏水量・漏水率の推移

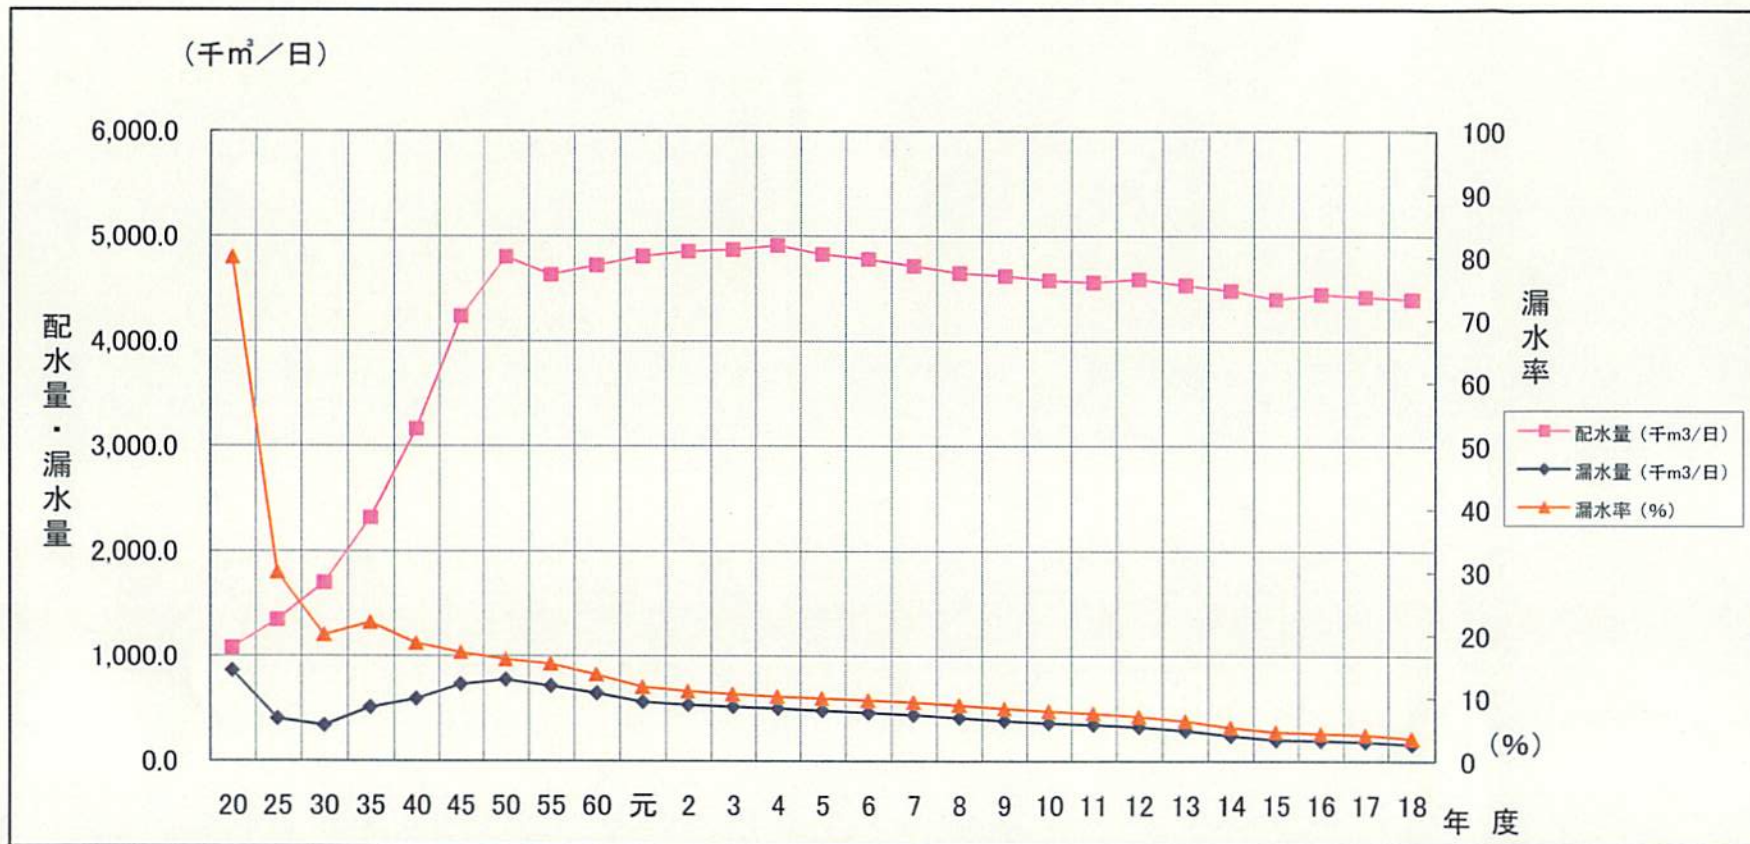

| | | | | | | | | | | | | | | |
|-----------------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|
| 年度 | 20 | 25 | 30 | 35 | 40 | 45 | 50 | 55 | 60 | 元 | 2 | 3 | 4 | 5 |
| 配水量 (千m ³ /日) | 1,077.1 | 1,344.3 | 1,698.3 | 2,320.5 | 3,166.6 | 4,237.2 | 4,805.5 | 4,636.4 | 4,723.0 | 4,809.5 | 4,858.0 | 4,872.4 | 4,911.6 | 4,830.0 |
| 漏水量 (千m ³ /日) | 861.7 | 403.3 | 339.7 | 510.5 | 590.6 | 728.8 | 773.7 | 714.1 | 647.6 | 564.0 | 537.5 | 517.1 | 502.4 | 480.1 |
| 漏水率 (%) | 80.0 | 30.0 | 20.0 | 22.0 | 18.7 | 17.2 | 16.1 | 15.4 | 13.7 | 11.7 | 11.1 | 10.6 | 10.2 | 9.9 |
| 年度 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | |
| 配水量 (千m ³ /日) | 4,784.1 | 4,718.5 | 4,650.0 | 4,626.9 | 4,582.1 | 4,564.4 | 4,596.2 | 4,535.8 | 4,489.1 | 4,406.1 | 4,451.0 | 4,427.1 | 4,401.1 | |
| 漏水量 (千m ³ /日) | 461.2 | 440.9 | 411.5 | 386.4 | 364.3 | 347.5 | 328.3 | 292.2 | 243.0 | 205.3 | 197.4 | 185.8 | 160.1 | |
| 漏水率 (%) | 9.6 | 9.3 | 8.9 | 8.4 | 8.0 | 7.6 | 7.1 | 6.4 | 5.4 | 4.7 | 4.4 | 4.2 | 3.6 | |